




**RAMP CONFIGURATION A**

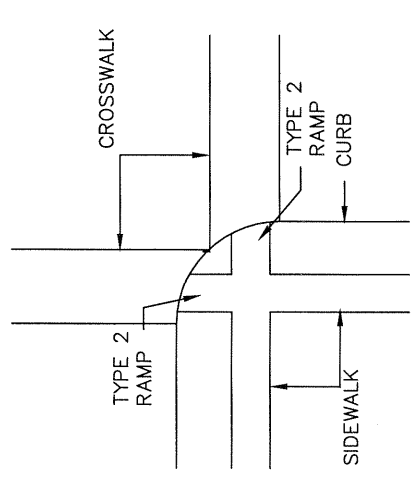


**RAMP CONFIGURATION B**

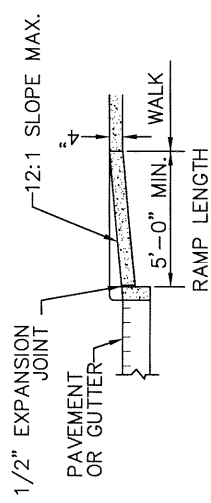


**SECTION A-A**

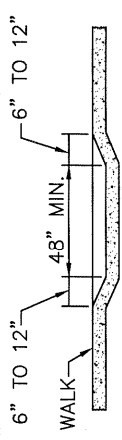

**SECTION D-D**



**SECTION C-C**

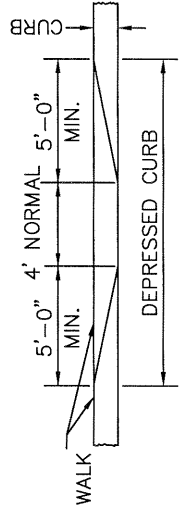


**VIEW B-B**


**CURB RAMPS NOTES**

- A. VILLAGE TO SPECIFY TYPE 1 OR TYPE 2 CURB RAMP.
- B. ANY COMBINATION OF SIDE SLOPES ON OPPOSITE SIDES OF A RAMP MAY BE USED TO BEST FIT THE SITE CONDITIONS.
- C. THE MINIMUM RAMP LENGTH IS 5' FROM BACK OF A 6" CURB AND MAY BE INCREASED WHERE FEASIBLE TO OBTAIN A FLATTER RAMP SLOPE OR TO BETTER BLEND WITH THE WALK CONFIGURATION.
- D. WALK THICKNESS IN THE RAMP SLOPES SHALL BE 4" MINIMUM OR THICKER AS NECESSARY TO MATCH ADJACENT WALK THICKNESS.
- E. CURB RAMPS SHALL MEET AND BE FINISHED TO A.D.A. STANDARDS.
- F. CURB RAMPS SHALL MEET THE REQUIREMENTS OF ODOT ITEM 608 UNLESS OTHERWISE SPECIFIED WITHIN.
- G. CONCRETE SHALL BE ODOT CLASS C (4000 PSI, 600 LB/CY CEMENT). PROPORTIONING OPTIONS 1 AND 2 NOT ALLOWED.
- H. CONCRETE SHALL CONTAIN 6% ± 1% OF TOTAL AIR.
- I. 4" OF COMPACTED ODOT ITEM 304 OR ITEM 411 AGGREGATE BASE SHALL BE PLACED ON COMPACTED SUBGRADE UNDER ALL SIDEWALK AND CURB RAMPS.

**TYPE 1 RAMP DETAIL**

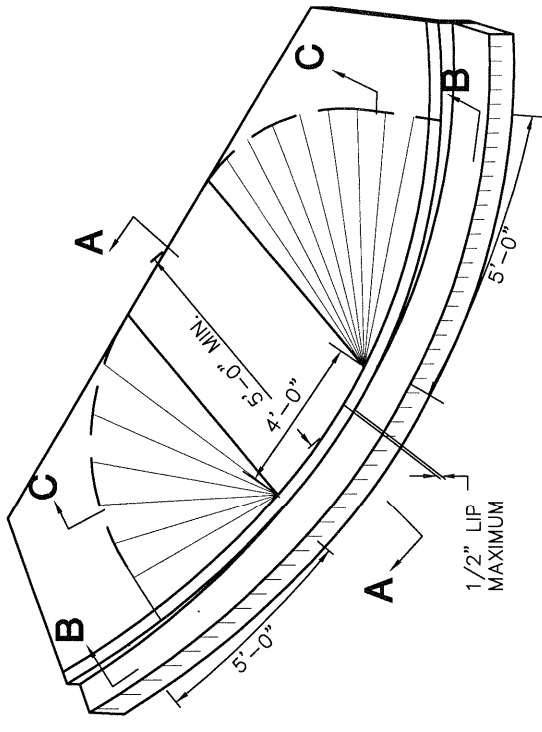

**TYPE 2 RAMP DETAIL**

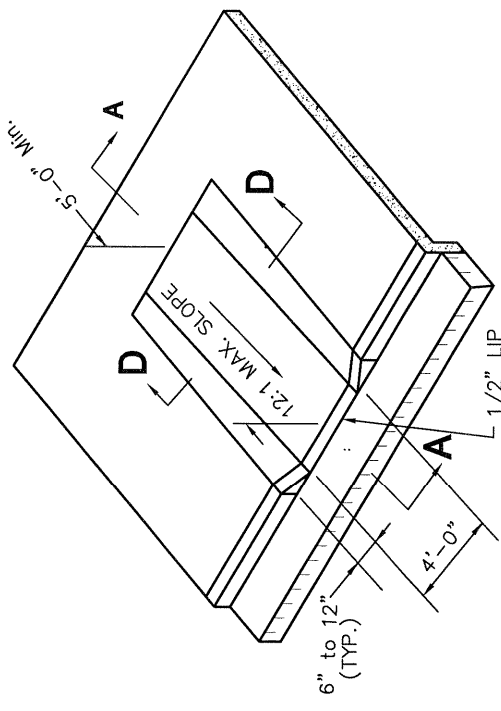

**CURB RAMPS**