


**LIMITED AREA SPRINKLER SYSTEM DETAIL**

REVISIONS:  
FEB. 2001

DATE APPROVED:  
AUG. 1999  
PAGE No.  
800-17

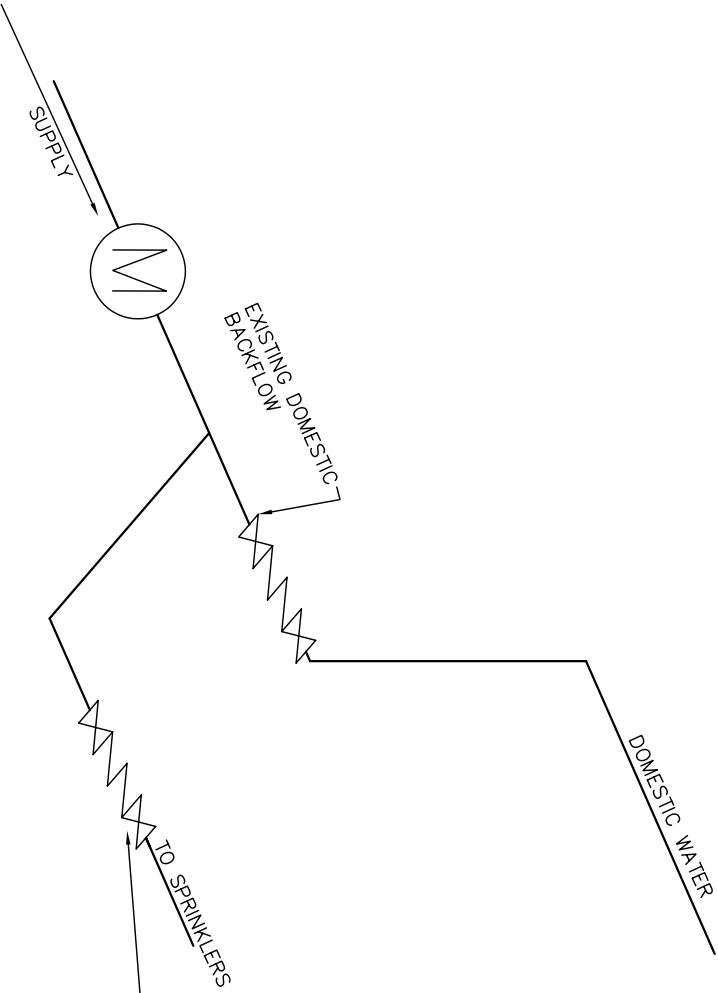

- 1. TESTABLE DOUBLE CHECK VALVE (ASSE 1015) AT POINT OF CONNECTION TO DOMESTIC PIPING
- 2. LOCKABLE VALVES "SUPERVISED" PER OHIO BASIC BUILDING CODE 10:20

**NOTE:**  
A. ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEM WILL AFFECT ORIGINAL FLOW CALCULATION

