


# REDUCED PRESSURE DETECTOR ASSEMBLY

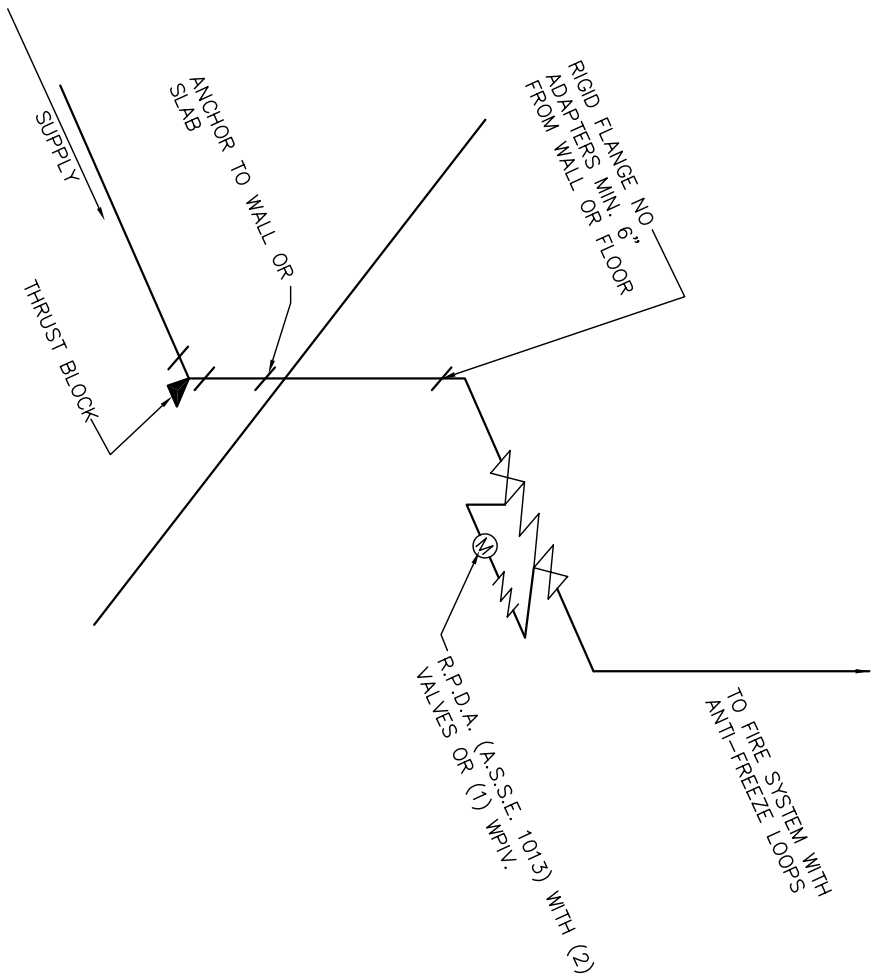

**NOTE:**

- A.** ALL BACKFLOW PREVENTION ASSEMBLIES SHALL BE DELIVERED FOR INSTALLATION COMPLETELY ASSEMBLED BY THE ORIGINAL MANUFACTURER WITH ALL COMPONENTS AS APPROVED
- B.** ADDITION OF BACKFLOW DEVICE ONTO EXISTING FIRE SUPPRESSION SYSTEMS WILL AFFECT ORIGINAL FLOW CALCULATIONS
- C.** CLASS 53 DUCTILE IRON TO VALVE. ALL JOINTS RESTRAINED

REVISIONS:  
FEB. 2001

DATE  
APPROVED:  
AUG. 1999  
PAGE No.

800-20