


WIRE SHALL HAVE 5' OF WIRE TO EXTEND OUT OF VALVE BOX

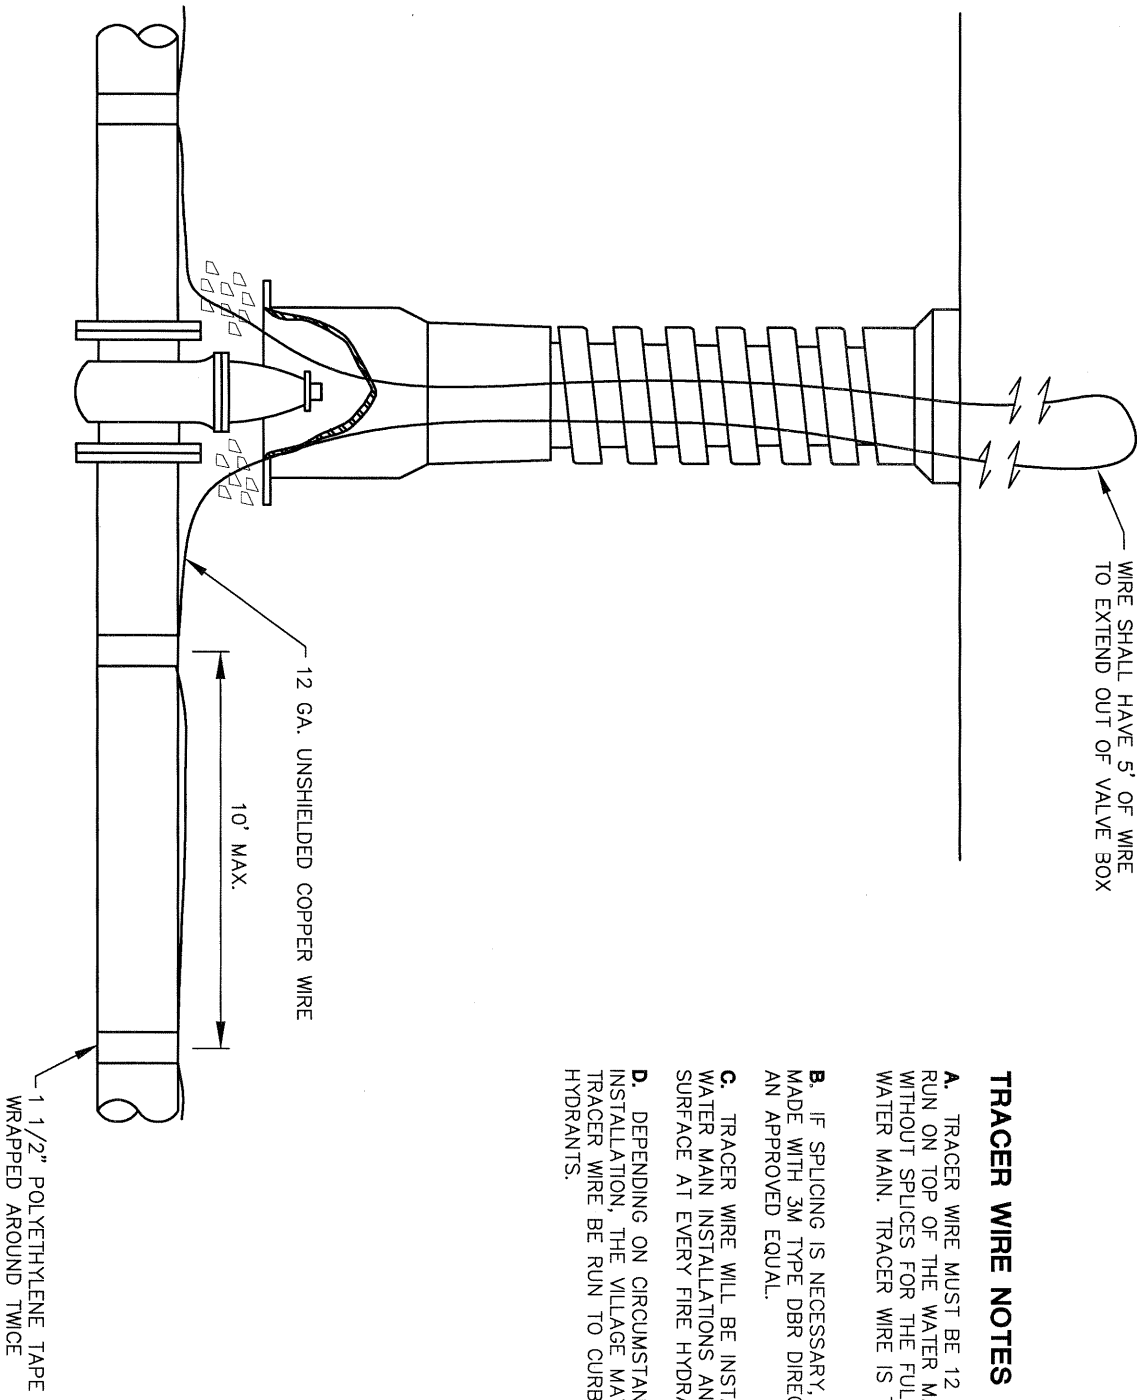


TRACER WIRE NOTES

- A.** TRACER WIRE MUST BE 12 GAUGE MINIMUM AND RUN ON TOP OF THE WATER MAIN CONTINUOUSLY WITHOUT SPLICES FOR THE FULL LENGTH OF THE WATER MAIN. TRACER WIRE IS TO BE BLUE IN COLOR.
- B.** IF SPLICING IS NECESSARY, ALL SPLICING SHALL BE MADE WITH 3M TYPE DBR DIRECT BURY SPICE KITS OR AN APPROVED EQUAL.
- C.** TRACER WIRE WILL BE INSTALLED ON ALL NEW PVC WATER MAIN INSTALLATIONS AND WILL COME TO THE SURFACE AT EVERY FIRE HYDRANT FOR TERMINATION.
- D.** DEPENDING ON CIRCUMSTANCES OF A SPECIFIC INSTALLATION, THE VILLAGE MAY ALSO REQUIRE THAT TRACER WIRE BE RUN TO CURB BOXES, OR FIRE HYDRANTS.

VILLAGE OF

ADA



TRACER WIRE FOR WATER MAIN PIPE DETAIL

REVISIONS:

DATE

APPROVED:
JUNE 2007

PAGE No.

800-24